



GDT > 2R - 4 series

Features


- ✧ Provide ultra-fast response to surge voltage from slow-rising surge of 100V/s to rapid-rising surge of 1KV/μs.
- ✧ Stable breakdown voltage.
- ✧ High insulation resistance.
- ✧ Low capacitance ($\leq 1\text{pF}$).
- ✧ High holdover voltage.
- ✧ Large absorbing transient current capability.
- ✧ Micro-Gap Design
- ✧ Size: 4.2mm*4.0mm
- ✧ Storage and operational temperature: $-40^{\circ}\text{C} \sim +85^{\circ}\text{C}$
- ✧ Meets MSL level 1, per J-STD-020



Application

- ✧ Repeaters, Modems.
- ✧ Telephone Interface, Line cards.
- ✧ Data communication equipment.
- ✧ Line test equipment.


Part Number Code

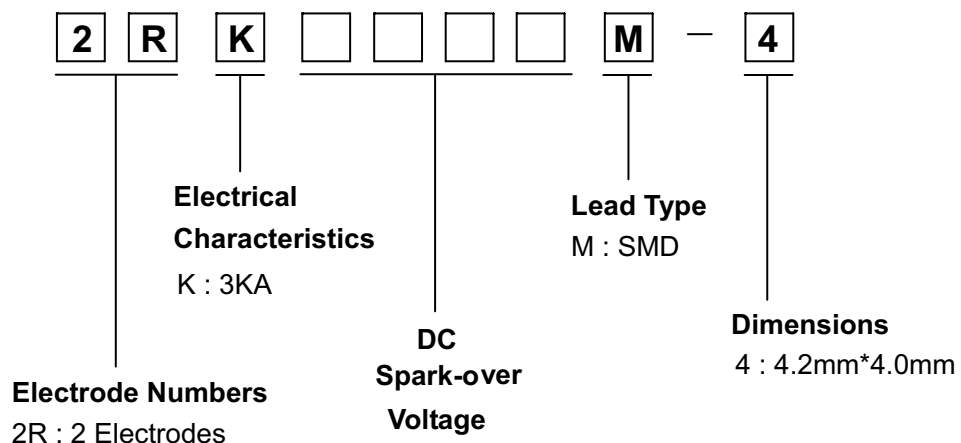



GDT > 2R - 4 series

Dimensions

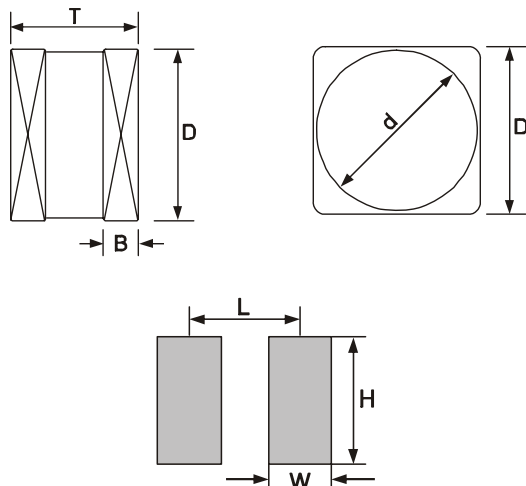

unit :mm

Items	Dimension	
	Spec.	Tolerance
D	4.2	±0.5
T	4.0	±0.4
B	0.4	±0.1
d	3.9	±0.1
L	3.5	-
H	5.0	-
W	1.3	-

Recommended Pad Size


Electrical Characteristic

Part Number	DC Spark-over Voltage	Maximum Impulse Spark-over Voltage	Nominal Impulse Discharge Current	Alternating Discharge Current	Impulse Life	Minimum Insulation Resistance		Maximum Capacitance	Device Marking Code
	100V/s	1000V/μs	8/20μs, 10times	50Hz, 1sec	10/1000μs, 100A	Test Voltage	(GΩ)	1MHz	
	(V)	(V)	(KA)	(A)	(times)	DC(V)		(pF)	
2RK075M-4	75±20%	800	3	3	300	25	1	1.0	075
2RK090M-4	90±20%	800	3	3	300	50	1	1.0	090
2RK145M-4	145±20%	800	3	3	300	100	1	1.0	145
2RK230M-4	230±20%	700	3	3	300	100	1	1.0	230
2RK250M-4	250±20%	700	3	3	300	100	1	1.0	250
2RK300M-4	300±20%	800	3	3	300	100	1	1.0	300
2RK350M-4	350±20%	850	3	3	300	100	1	1.0	350
2RK400M-4	400±20%	900	3	3	300	100	1	1.0	400
2RK470M-4	470±20%	800	3	3	300	250	1	1.0	470
2RK600M-4	600±20%	1100	3	3	300	250	1	1.0	600
2RK800M-4	800±20%	1200	3	3	300	250	1	1.0	800
2RK1000M-4	1000±20%	1500	3	3	300	500	1	1.0	1000
2RK1200M-4	1200±20%	1900	3	3	300	500	1	1.0	1200



GDT > 2R - 4 series

Electrical Rating

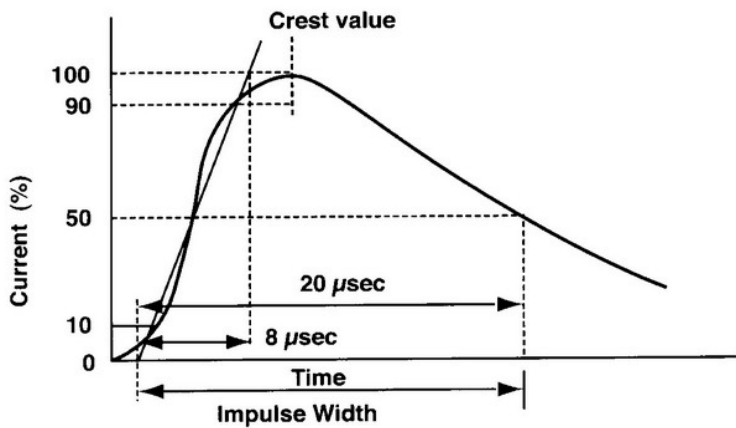Item	Test Condition / Description	Requirement
DC Spark-over Voltage	The voltage is measured with a low rate of rise $dv / dt = 100V/s$	To meet the specified value
Maximum Impulse Spark-over Voltage	The maximum impulse breakdown voltage is measured with a rise time of $dv / dt = 1000V/\mu s$	
Impulse Discharge Current	The maximum current applying a waveform of 8/20μs that can be applied across the terminals of the gas tube without causing the gas tube to change more than $\pm 25\%$ from its initial measured DC breakdown voltage. Dwell time between pulses is 3 minutes. 	
Alternating Discharge Current	Rated RMS value of AC current at 50Hz, 1 sec. 10 times. Intervals: 3min. DC breakdown voltage may not change more than $\pm 25\%$ from its initial measured DC breakdown voltage. $IR > 10^8$ ohms (-20%, +30% for 70 – 90V).	
Insulation Resistance	The resistance of gas tube shall be measured each terminal each other terminal. please see above spec	
Capacitance	The capacitance of gas tube shall be measured each terminal to each other terminal. Test frequency : 1MHz	