



GDT > 3R - 5 - SS series

Features


- ✧ Provide ultra-fast response to surge voltage from slow-rising surge of 100V/s to rapid-rising surge of 1KV/μs.
- ✧ Stable breakdown voltage.
- ✧ High insulation resistance.
- ✧ Low capacitance (≤2pF).
- ✧ High holdover voltage.
- ✧ Large absorbing transient current capability.
- ✧ Micro-Gap Design
- ✧ SIZE: 5.0*7.2mm
- ✧ Storage and operational temperature: -40°C ~ +85°C
- ✧ Meets MSL level 1, per J -STD-020



Application

- ✧ Repeaters, Modems.
- ✧ Telephone Interface, Line cards.
- ✧ Data communication equipment.
- ✧ Line test equipment.


Part Number Code

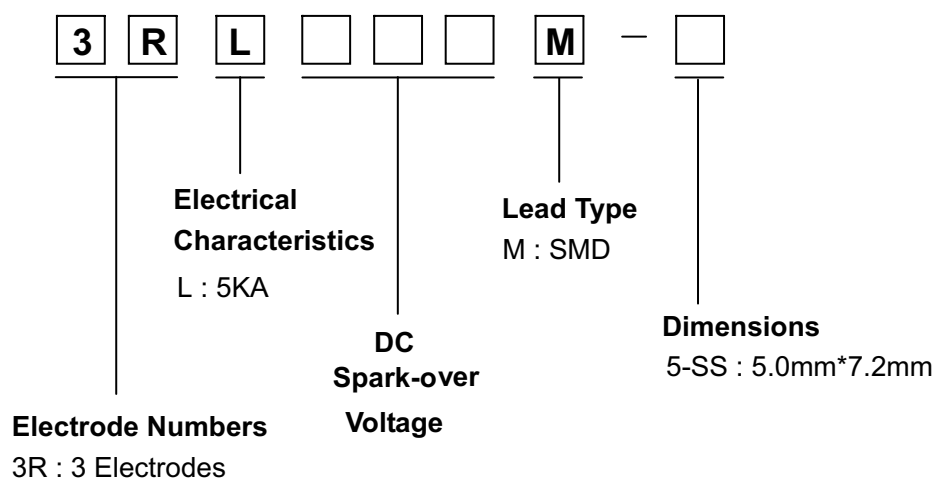



GDT > 3R - 5 - SS series

Dimensions

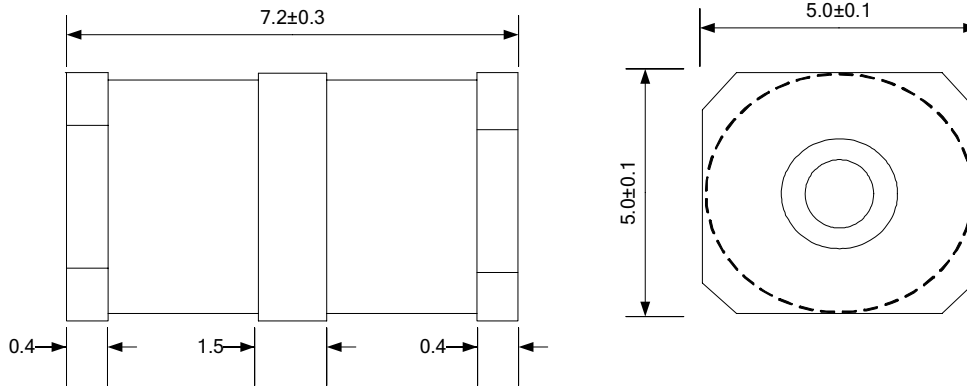

SS TYPE

Electrical Characteristic


Part Number	DC Spark-over Voltage	Maximum Impulse Spark-over Voltage	Nominal Impulse Discharge Current	Alternating Discharge Current	Impulse Life	Minimum Insulation Resistance		Maximum Capacitance
	100V/s	1000V/μs	8/20μs 10times	50Hz,0.2sec	10/1000μs, 200A	Test Voltage	(GΩ)	1MHz
	(V)	(V)	(KA)	(A)	(times)	DC(V)		(pF)
3RL075M-5-SS 3RL75M-5-SS	75±20%	700	5	5	300	25	1.0	2.0
3RL090M-5-SS 3RL90M-5-SS	90±20%	600	5	5	300	50	1.0	2.0
3RL120M-5-SS	120±20%	600	5	5	300	50	1.0	2.0
3RL150M-5-SS	150±20%	600	5	5	300	100	1.0	2.0

Note: Impulse discharge current for GDT is the total current equally divided between each line to ground



GDT > 3R - 5 - SS series

Electrical Rating

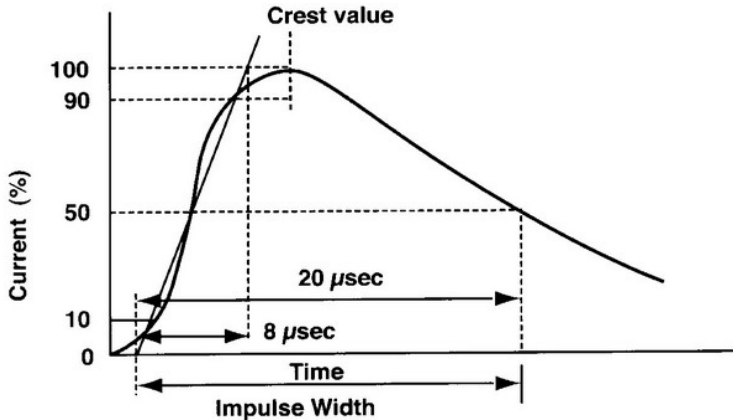Item	Test Condition / Description	Requirement
DC Spark-over Voltage	The voltage is measured with a low rate of rise $dv / dt=100V/s$	To meet the specified value
Maximum Impulse Spark-over Voltage	The maximum impulse breakdown voltage is measured with a rise time of $dv / dt=1000V/\mu s$	
Impulse Discharge Current	<p>The maximum current within gas tube voltage charge of $\pm 30\%$ when one impulse is applied.</p> <p>Applied waveform: 8/20μs</p>  <p>The graph shows a current waveform starting at 0, rising to a crest value of 100% within 8 μs, and then decaying to 50% at 20 μs. The x-axis is labeled 'Time' and 'Impulse Width', and the y-axis is labeled 'Current (%)'.</p>	
Alternating Discharge Current	<p>Rated RMS value of AC current at 50Hz, 0.2 sec.</p> <p>DC breakdown voltage may not change more than $\pm 30\%$ from its initial measured DC breakdown voltage.</p> <p>$IR > 10^8$ ohms (-20%, +30% for 70 – 90V).</p>	
Insulation Resistance	The resistance of gas tube shall be measured each terminal each other terminal. please see above spec	
Capacitance	<p>The capacitance of gas tube shall be measured each terminal to each other terminal.</p> <p>Test frequency :1MHz</p>	